

APPENDIX F

RADON CONTROL METHODS

SECTION AF101 SCOPE

AF101.1 General. This appendix contains requirements for new construction in jurisdictions where radon-resistant construction is required.

Inclusion of this appendix by jurisdictions shall be determined through the use of locally available data or determination of Zone 1 designation in Figure AF101.

SECTION AF102 DEFINITIONS

AF102.1 General. For the purpose of these requirements, the terms used shall be defined as follows:

SUB-SLAB DEPRESSURIZATION SYSTEM (Passive). A system designed to achieve lower sub-slab air pressure relative to indoor air pressure by use of a vent pipe routed through the conditioned space of a building and connecting the sub-slab area with outdoor air, thereby relying on the convective flow of air upward in the vent to draw air from beneath the slab.

SUB-SLAB DEPRESSURIZATION SYSTEM (Active). A system designed to achieve lower sub-slab air pressure relative to indoor air pressure by use of a fan-powered vent drawing air from beneath the slab.

DRAIN TILE LOOP. A continuous length of drain tile or perforated pipe extending around all or part of the internal or external perimeter of a basement or crawl space footing.

RADON GAS. A naturally-occurring, chemically inert, radioactive gas that is not detectable by human senses. As a gas, it can move readily through particles of soil and rock and can accumulate under the slabs and foundations of homes where it can easily enter into the living space through construction cracks and openings.

SOIL-GAS-RETARDER. A continuous membrane of 6-mil (0.15 mm) polyethylene or other equivalent material used to retard the flow of soil gases into a building.

SUB-MEMBRANE DEPRESSURIZATION SYSTEM. A system designed to achieve lower-sub-membrane air pressure relative to crawl space air pressure by use of a vent drawing air from beneath the soil-gas-retarder membrane.

SECTION AF103 REQUIREMENTS

AF103.1 General. The following construction techniques are intended to resist radon entry and prepare the building for post-

construction radon mitigation, if necessary (see Figure AF102). These techniques are required in areas where designated by the jurisdiction.

AF103.2 Subfloor preparation. A layer of gas-permeable material shall be placed under all concrete slabs and other floor systems that directly contact the ground and are within the walls of the living spaces of the building, to facilitate future installation of a sub-slab depressurization system, if needed. The gas-permeable layer shall consist of one of the following:

4. A uniform layer of clean aggregate, a minimum of 4 inches (102 mm) thick. The aggregate shall consist of material that will pass through a 2-inch (51 mm) sieve and be retained by a 1/4-inch (6.4 mm) sieve.
5. A uniform layer of sand (native or fill), a minimum of 4 inches (102 mm) thick, overlain by a layer or strips of geotextile drainage matting designed to allow the lateral flow of soil gases.
6. Other materials, systems or floor designs with demonstrated capability to permit depressurization across the entire sub-floor area.

AF103.3 Soil-gas-retarder. A minimum 6-mil (0.15 mm) [or 3-mil (0.075 mm) cross-laminated] polyethylene or equivalent flexible sheeting material shall be placed on top of the gas-permeable layer prior to casting the slab or placing the floor assembly to serve as a soil-gas-retarder by bridging any cracks that develop in the slab or floor assembly and to prevent concrete from entering the void spaces in the aggregate base material. The sheeting shall cover the entire floor area with separate sections of sheeting lapped at least 12 inches (305 mm). The sheeting shall fit closely around any pipe, wire or other penetrations of the material. All punctures or tears in the material shall be sealed or covered with additional sheeting.

AF103.4 Entry routes. Potential radon entry routes shall be closed in accordance with Sections AF103.4.1 through AF103.4.10.

AF103.4.1 Floor openings. Openings around bathtubs, showers, water closets, pipes, wires or other objects that penetrate concrete slabs or other floor assemblies shall be filled with a polyurethane caulk or equivalent sealant applied in accordance with the manufacturer's recommendations.

AF103.4.2 Concrete joints. All control joints, isolation joints, construction joints and any other joints in concrete slabs or between slabs and foundation walls shall be sealed with a caulk or sealant. Gaps and joints shall be cleared of loose material and filled with polyurethane caulk or other elastomeric sealant applied in accordance with the manufacturer's recommendations.

AF103.4.3 Condensate drains. Condensate drains shall be trapped or routed through nonperforated pipe to daylight.

AF103.4.4 Sumps. Sump pits open to soil or serving as the termination point for sub-slab or exterior drain tile loops shall be covered with a gasketed or otherwise sealed lid. Sumps used as the suction point in a sub-slab depressurization system shall have a lid designed to accommodate the vent pipe. Sumps used as a floor drain shall have a lid equipped with a trapped inlet.

AF103.4.5 Foundation walls. Hollow block masonry foundation walls shall be constructed with either a continuous course of solid masonry, one course of masonry grouted solid, or a solid concrete beam at or above finished ground surface to prevent passage of air from the interior of the wall into the living space. Where a brick veneer or other masonry ledge is installed, the course immediately below that ledge shall be sealed. Joints, cracks or other openings around all penetrations of both exterior and interior surfaces of masonry block or wood foundation walls below the ground surface shall be filled with polyurethane caulk or equivalent sealant. Penetrations of concrete walls shall be filled.

AF103.4.6 Dampproofing. The exterior surfaces of portions of concrete and masonry block walls below the ground surface shall be dampproofed in accordance with Section R406 of this code.

AF103.4.7 Air-handling units. Air-handling units in crawl spaces shall be sealed to prevent air from being drawn into the unit.

Exception: Units with gasketed seams or units that are otherwise sealed by the manufacturer to prevent leakage.

AF103.4.8 Ducts. Ductwork passing through or beneath a slab shall be of seamless material unless the air-handling system is designed to maintain continuous positive pressure within such ducting. Joints in such ductwork shall be sealed to prevent air leakage.

Ductwork located in crawl spaces shall have all seams and joints sealed by closure systems in accordance with Section M1601.3.1.

AF103.4.9 Crawl space floors. Openings around all penetrations through floors above crawl spaces shall be caulked or otherwise filled to prevent air leakage.

AF103.4.10 Crawl space access. Access doors and other openings or penetrations between basements and adjoining crawl spaces shall be closed, gasketed or otherwise filled to prevent air leakage.

AF103.5 Passive sub-membrane depressurization system. In buildings with crawl space foundations, the following components of a passive sub-membrane depressurization system shall be installed during construction.

Exception: Buildings in which an approved mechanical crawl space ventilation system or other equivalent system is installed.

AF103.5.1 Ventilation. Crawl spaces shall be provided with vents to the exterior of the building. The minimum net area

of ventilation openings shall comply with Section R408.1 of this code.

AF103.5.2 Soil-gas-retarder. The soil in crawl spaces shall be covered with a continuous layer of minimum 6-mil (0.15 mm) polyethylene soil-gas-retarder. The ground cover shall be lapped a minimum of 12 inches (305 mm) at joints and shall extend to all foundation walls enclosing the crawl space area.

AF103.5.3 Vent pipe. A plumbing tee or other approved connection shall be inserted horizontally beneath the sheeting and connected to a 3- or 4-inch-diameter (76 mm or 102 mm) fitting with a vertical vent pipe installed through the sheeting. The vent pipe shall be extended up through the building floors, terminate at least 12 inches (305 mm) above the roof in a location at least 10 feet (3048 mm) away from any window or other opening into the conditioned spaces of the building that is less than 2 feet (610 mm) below the exhaust point, and 10 feet (3048 mm) from any window or other opening in adjoining or adjacent buildings.

AF103.6 Passive sub-slab depressurization system. In basement or slab-on-grade buildings, the following components of a passive sub-slab depressurization system shall be installed during construction.

AF103.6.1 Vent pipe. A minimum 3-inch-diameter (76 mm) ABS, PVC or equivalent gas-tight pipe shall be embedded vertically into the sub-slab aggregate or other permeable material before the slab is cast. A “T” fitting or equivalent method shall be used to ensure that the pipe opening remains within the sub-slab permeable material. Alternatively, the 3-inch (76 mm) pipe shall be inserted directly into an interior perimeter drain tile loop or through a sealed sump cover where the sump is exposed to the sub-slab aggregate or connected to it through a drainage system.


The pipe shall be extended up through the building floors, terminate at least 12 inches (305 mm) above the surface of the roof in a location at least 10 feet (3048 mm) away from any window or other opening into the conditioned spaces of the building that is less than 2 feet (610 mm) below the exhaust point, and 10 feet (3048 mm) from any window or other opening in adjoining or adjacent buildings.

AF103.6.2 Multiple vent pipes. In buildings where interior footings or other barriers separate the sub-slab aggregate or other gas-permeable material, each area shall be fitted with an individual vent pipe. Vent pipes shall connect to a single vent that terminates above the roof or each individual vent pipe shall terminate separately above the roof.

AF103.7 Vent pipe drainage. All components of the radon vent pipe system shall be installed to provide positive drainage to the ground beneath the slab or soil-gas-retarder.

AF103.8 Vent pipe accessibility. Radon vent pipes shall be accessible for future fan installation through an attic or other area outside the habitable space.

Exception: The radon vent pipe need not be accessible in an attic space where an approved roof-top electrical supply is provided for future use.

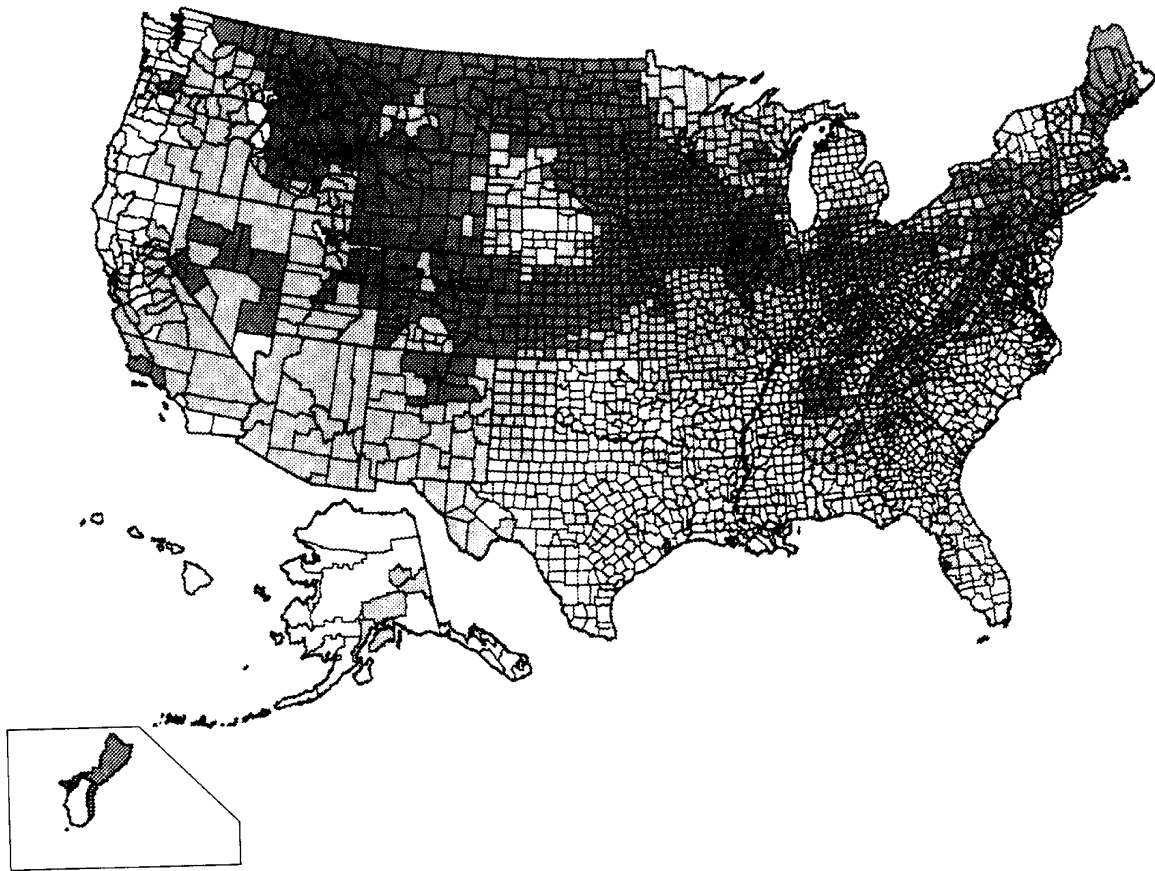

LEGEND

- ZONE 1 HIGH POTENTIAL (GREATER THAN 4 pCi/L^a)
- ZONE 2 MODERATE POTENTIAL (FROM 2 TO 4 pCi/L)
- ZONE 3 LOW POTENTIAL (LESS THAN 2 pCi/L)

a. pCi/L standard for picocuries per liter of radon gas. EPA recommends that all homes that measure 4 pCi/L and greater be mitigated.

The United States Environmental Protection Agency and the United States Geological Survey have evaluated the radon potential in the United States and have developed a map of radon zones designed to assist building officials in deciding whether radon-resistant features are applicable in new construction.

The map assigns each of the 3,141 counties in the United States to one of three zones based on radon potential. Each zone designation reflects the average short-term radon measurement that can be expected to be measured in a building without the implementation of radon control methods. The radon zone designation of highest priority is Zone 1. Table 1 of this appendix lists the Zone 1 counties illustrated on the map. More detailed information can be obtained from state-specific booklets (EPA-402-R-93-021 through 070) available through State Radon Offices or from U.S. EPA Regional Offices.

FIGURE AF101
EPA MAP OF RADON ZONES

TABLE AF101(1)
HIGH RADON POTENTIAL (ZONE 1) COUNTIES^a

ALABAMA	New London	Schuyler	Barton	Fayette	Fillmore	Carbon
Calhoun		Scott	Brown	Franklin	Freeborn	Carter
Clay	GEORGIA	Stark	Cheyenne	Green	Goodhue	Cascade
Cleburne	Cobb	Stephenson	Clay	Harrison	Grant	Chouteau
Colbert	De Kalb	Tazewell	Cloud	Hart	Hennepin	Custer
Coosa	Fulton	Vermilion	Decatur	Jefferson	Houston	Daniels
Franklin	Gwinnett	Warren	Dickinson	Jessamine	Hubbard	Dawson
Jackson		Whiteside	Douglas	Lincoln	Jackson	Deer Lodge
Lauderdale	IDAHO	Winnebago	Ellis	Marion	Kanabec	Fallon
Lawrence	Benewah	Woodford	Ellsworth	Mercer	Kandiyohi	Fergus
Limestone	Blaine		Finney	Metcalfe	Kittson	Flathead
Madison	Boise	INDIANA	Ford	Monroe	Lac Qui Parle	Gallatin
Morgan	Bonner	Adams	Geary	Nelson	Le Sueur	Garfield
Talladega	Boundary	Allen	Gove	Pendleton	Lincoln	Glacier
	Butte	Bartholomew	Graham	Pulaski	Lyon	Granite
CALIFORNIA	Camas	Benton	Grant	Robertson	Mahnommen	Hill
Santa Barbara	Clark	Blackford	Gray	Russell	Marshall	Jefferson
Ventura	Clearwater	Boone	Greeley	Scott	Martin	Judith Basin
	Custer	Carroll	Hamilton	Taylor	McLeod	Lake
COLORADO	Elmore	Cass	Haskell	Warren	Meeker	Lewis and Clark
Adams	Fremont	Clark	Hodgeman	Woodford	Mower	Liberty
Arapahoe	Gooding	Clinton	Jackson		Murray	Lincoln
Baca	Idaho	De Kalb	Jewell	MAINE	Nicollet	Madison
Bent	Kootenai	Decatur	Johnson	Androscoggin	Nobles	McCone
Boulder	Latah	Delaware	Kearny	Aroostook	Norman	Meagher
Chaffee	Lemhi	Elkhart	Kingman	Cumberland	Olmsted	Mineral
Cheyenne	Shoshone	Fayette	Kiowa	Franklin	Otter Tail	Missoula
Clear Creek	Valley	Fountain	Lane	Hancock	Pennington	Park
Crowley	ILLINOIS	Fulton	Leavenworth	Kennebec	Pipestone	Phillips
Custer	Adams	Grant	Lincoln	Lincoln	Polk	Pondera
Delta	Boone	Hamilton	Logan	Oxford	Pope	Powder River
Denver	Brown	Hancock	Marion	Penobscot	Ramsey	Powell
Dolores	Bureau	Harrison	Marshall	Piscataquis	Red Lake	Prairie
Douglas	Calhoun	Hendricks	McPherson	Somerset	Redwood	Ravalli
El Paso	Carroll	Henry	Meade	York	Renville	Richland
Elbert	Cass	Howard	Mitchell		Rice	Roosevelt
Fremont	Champaign	Huntington	Nemaha	MARYLAND	Rock	Rosebud
Garfield	Coles	Jay	Ness	Baltimore	Roseau	Sanders
Gilpin	De Kalb	Jennings	Norton	Calvert	Scott	Sheridan
Grand	De Witt	Johnson	Osborne	Carroll	Sherburne	Silver Bow
Gunnison	Douglas	Kosciusko	Ottawa	Frederick	Sibley	Stillwater
Huerfano	Huerfano	Lagrange	Pawnee	Harford	Stearns	Teton
Jackson	Jackson	Lawrence	Phillips	Howard	Steele	Toole
Jefferson	Jefferson	Madison	Pottawatomie	Montgomery	Stevens	Valley
Kiowa	Kiowa	Marion	Pratt	Washington	Swift	Wibaux
Kit Carson	Kit Carson	Marshall	Rawlins		Todd	Yellowstone
Lake	Lake	Miami	Republic	MASS.	Traverse	National Park
Larimer	Larimer	Monroe	Rice	Essex	Wabasha	
Las Animas	Las Animas	Montgomery	Riley	Middlesex	Wadena	NEBRASKA
Lincoln	Lincoln	Noble	Rooks	Worcester	Waseca	Adams
Logan	Logan	Orange	Rush		Washington	Boone
Mesa	Mesa	Putnam	Russell	MICHIGAN	Watsonwan	Boyd
Moffat	Moffat	Randolph	Saline	Branch	Wilkin	Burt
Montezuma	Montezuma	Rush	Scott	Calhoun	Winona	Butler
Montrose	Montrose	Scott	Sheridan	Cass	Wright	Cass
Morgan	Morgan	Shelby	Sherman	Hillsdale	Yellow Medicine	Cedar
Otero	Otero	Steuben	Smith	Jackson		Clay
Ouray	Ouray	St. Joseph	Stanton	Kalamazoo	MISSOURI	Colfax
Park	Park	Tippecanoe	Thomas	Lenawee	Andrew	Cuming
Phillips	Phillips	Tipton	Trego	St. Joseph	Atchison	Dakota
Pitkin	Pitkin	Union	Wallace	Washtenaw	Buchanan	Dixon
Prowers	Prowers	Vermillion	Washington		Cass	Dodge
Pueblo	Pueblo	Wabash	Wichita	MINNESOTA	Clay	Douglas
Rio Blanco	Rio Blanco	Warren	Wyandotte	Becker	Clinton	Fillmore
San Miguel	San Miguel	Washington		Big Stone	Holt	Franklin
Summit	Summit	Wayne		Blue Earth	Iron	Frontier
Teller	Teller	Wells	KENTUCKY	Brown	Jackson	Furnas
Washington	Washington	White	Adair	Carver	Nodaway	Gage
Weld	Weld	Whitley	Allen	Chippewa	Platte	Gosper
Yuma	Yuma		Barren	Clay		Greeley
			Bourbon	Cottonwood	MONTANA	Hamilton
CONNECTICUT		IOWA	Boyle	Dakota	Beaverhead	Harlan
Fairfield		All Counties	Bullitt	Dodge	Big Horn	Hayes
Middlesex		KANSAS	Casey	Douglas	Blaine	Hitchcock
New Haven		Atchison	Clark	Faribault	Broadwater	
			Cumberland			

a. EPA recommends that this county listing be supplemented with other available State and local data to further understand the radon potential of Zone 1 areas.

(continued)

TABLE AF101(1)—continued
HIGH RADON POTENTIAL (ZONE 1) COUNTIES^a

Hurston	Cayuga	Hardin	Monroe	Stanley	Buena Vista	Hardy
Jefferson	Chautauqua	Harrison	Montgomery	Sully	Campbell	Jefferson
Johnson	Chemung	Holmes	Montour	Turner	Chesterfield	Marshall
Kearney	Chenango	Huron	Northampton	Union	Clarke	Mercer
Knox	Columbia	Jefferson	Northumberland	Walworth	Clifton Forge	Mineral
Lancaster	Cortland	Knox	Perry	Yankton	Covington	Monongalia
Madison	Delaware	Licking	Schuylkill		Craig	Monroe
Nance	Dutchess	Logan	Snyder	TENNESEE	Cumberland	Morgan
Nemaha	Erie	Madison	Sullivan	Anderson	Danville	Ohio
Nuckolls	Genesee	Marion	Susquehanna	Bedford	Dinwiddie	Pendleton
Otoe	Greene	Mercer	Tioga	Blount	Fairfax	Pocahontas
Pawnee	Livingston	Miami	Union	Bradley	Falls Church	Preston
Phelps	Madison	Montgomery	Venango	Claiborne	Fluvanna	Summers
Pierce	Onondaga	Morrow	Westmoreland	Davidson	Frederick	Wetzel
Platte	Ontario	Muskingum	Wyoming	Giles	Fredericksburg	
Polk	Orange	Perry	York	Grainger	Giles	WISCONSIN
Red Willow	Otsego	Pickaway		Greene	Goochland	Buffalo
Richardson	Putnam	Pike	RHODE ISLAND	Hamblen	Harrisonburg	Crawford
Saline	Rensselaer	Preble	Kent	Hancock	Henry	Dane
Sarpy	Schoharie	Richland	Washington	Hawkins	Highland	Dodge
Saunders	Schuyler	Ross		Hickman	Lee	Door
Seward	Seneca	Seneca		Humphreys	Lexington	Fond du Lac
Stanton	Shelby	Shelby	S. CAROLINA	Jackson	Louisa	Grant
Thayer	Sullivan	Stark	Greenville	Jefferson	Martinsville	Green
Washington	Tioga	Summit		Knox	Montgomery	Green Lake
Wayne	Tompkins	Tuscarawas	S. DAKOTA	Lawrence	Nottoway	Iowa
Webster	Ulster	Union	Aurora	Lewis	Orange	Jefferson
York	Washington	Van Wert	Beadle	Lincoln	Page	Lafayette
	Wyoming	Warren	Bon Homme	Loudon	Patrick	Langlade
	Yates	Wayne	Brookings	Marshall	Pittsylvania	Marathon
NEW HAMPSHIRE		Wyandot	Brown	Maury	Powhatan	Menominee
Carroll	N. CAROLINA		Brule	McMinn	Pulaski	Pepin
	Allegheny	PENNSYLVANIA	Buffalo	Meigs	Radford	Pierce
NEW JERSEY	Buncombe	Adams	Campbell	Monroe	Roanoke	Portage
Hunterdon	Cherokee	Allegheny	Charles Mix	Moore	Rockbridge	Richland
Mercer	Henderson	Armstrong	Clark	Perry	Rockingham	Rock
Monmouth	Mitchell	Beaver	Clay	Roane	Russell	Shawano
Morris	Rockingham	Bedford	Codington	Rutherford	Salem	St. Croix
Somerset	Transylvania	Berks	Corson	Smith	Scott	Vernon
Sussex	Watauga	Blair	Davison	Sullivan	Shenandoah	Walworth
Warren		Bradford	Day	Trousdale	Smyth	Washington
	N. DAKOTA	Butler	Deuel	Union	Spotsylvania	Waukesha
NEW MEXICO	All Counties	Bradford	Douglas	Washington	Stafford	Waupaca
Bernalillo		Bucks	Edmunds	Wayne	Staunton	Wood
Colfax	OHIO	Butler	Faulk	Williamson	Tazewell	
Mora	Adams	Cameron	Grant	Wilson	Warren	WYOMING
Rio Arriba	Allen	Carbon	Hamlin		Washington	Albany
San Miguel	Ashland	Centre	Hand	UTAH	Waynesboro	Big Horn
Santa Fe	Auglaize	Chester	Hanson	Carbon	Winchester	Campbell
Taos	Belmont	Clearfield	Hughes	Duchesne	Wythe	Carbon
	Butler	Clinton	Hutchinson	Grand		Converse
NEVADA	Carroll	Columbia	Hyde	Piute	WASHINGTON	Crook
Carson City	Champaign	Cumberland	Jerauld	Sanpete	Clark	Fremont
Douglas	Clark	Dauphin	Kingsbury	Sevier	Ferry	Goshen
Eureka	Clinton	Delaware	Lake	Okanogan	Okanogan	Hot Springs
Lander	Columbiana	Franklin	Lincoln	Pend Oreille	Skamania	Johnson
Lincoln	Coshocton	Fulton	Lyman	Spokane	Stevens	Laramie
Lyon	Crawford	Huntingdon	Marshall			Lincoln
Mineral	Darke	Indiana	McCook	VIRGINIA		Natrona
Pershing	Delaware	Juniata	McPherson	Allegheny		Niobrara
White Pine	Fairfield	Lackawanna	Miner	Amelia		Park
	Fayette	Lancaster	Minnehaha	Appomattox	W. VIRGINIA	Sheridan
NEW YORK	Franklin	Lebanon	Moody	Augusta	Berkeley	Sublette
Albany	Greene	Lehigh	Perkins	Bath	Bland	Sweetwater
Allegheny	Guernsey	Luzerne	Potter	Botetourt	Grant	Teton
Broome	Hamilton	Lycoming	Roberts	Bristol	Greenbrier	Uinta
Cattaraugus	Hancock	Mifflin	Sanborn	Brunswick	Hampshire	Washakie
			Spink	Buckingham	Hancock	

a. EPA recommends that this county listing be supplemented with other available State and local data to further understand the radon potential of Zone 1 areas.

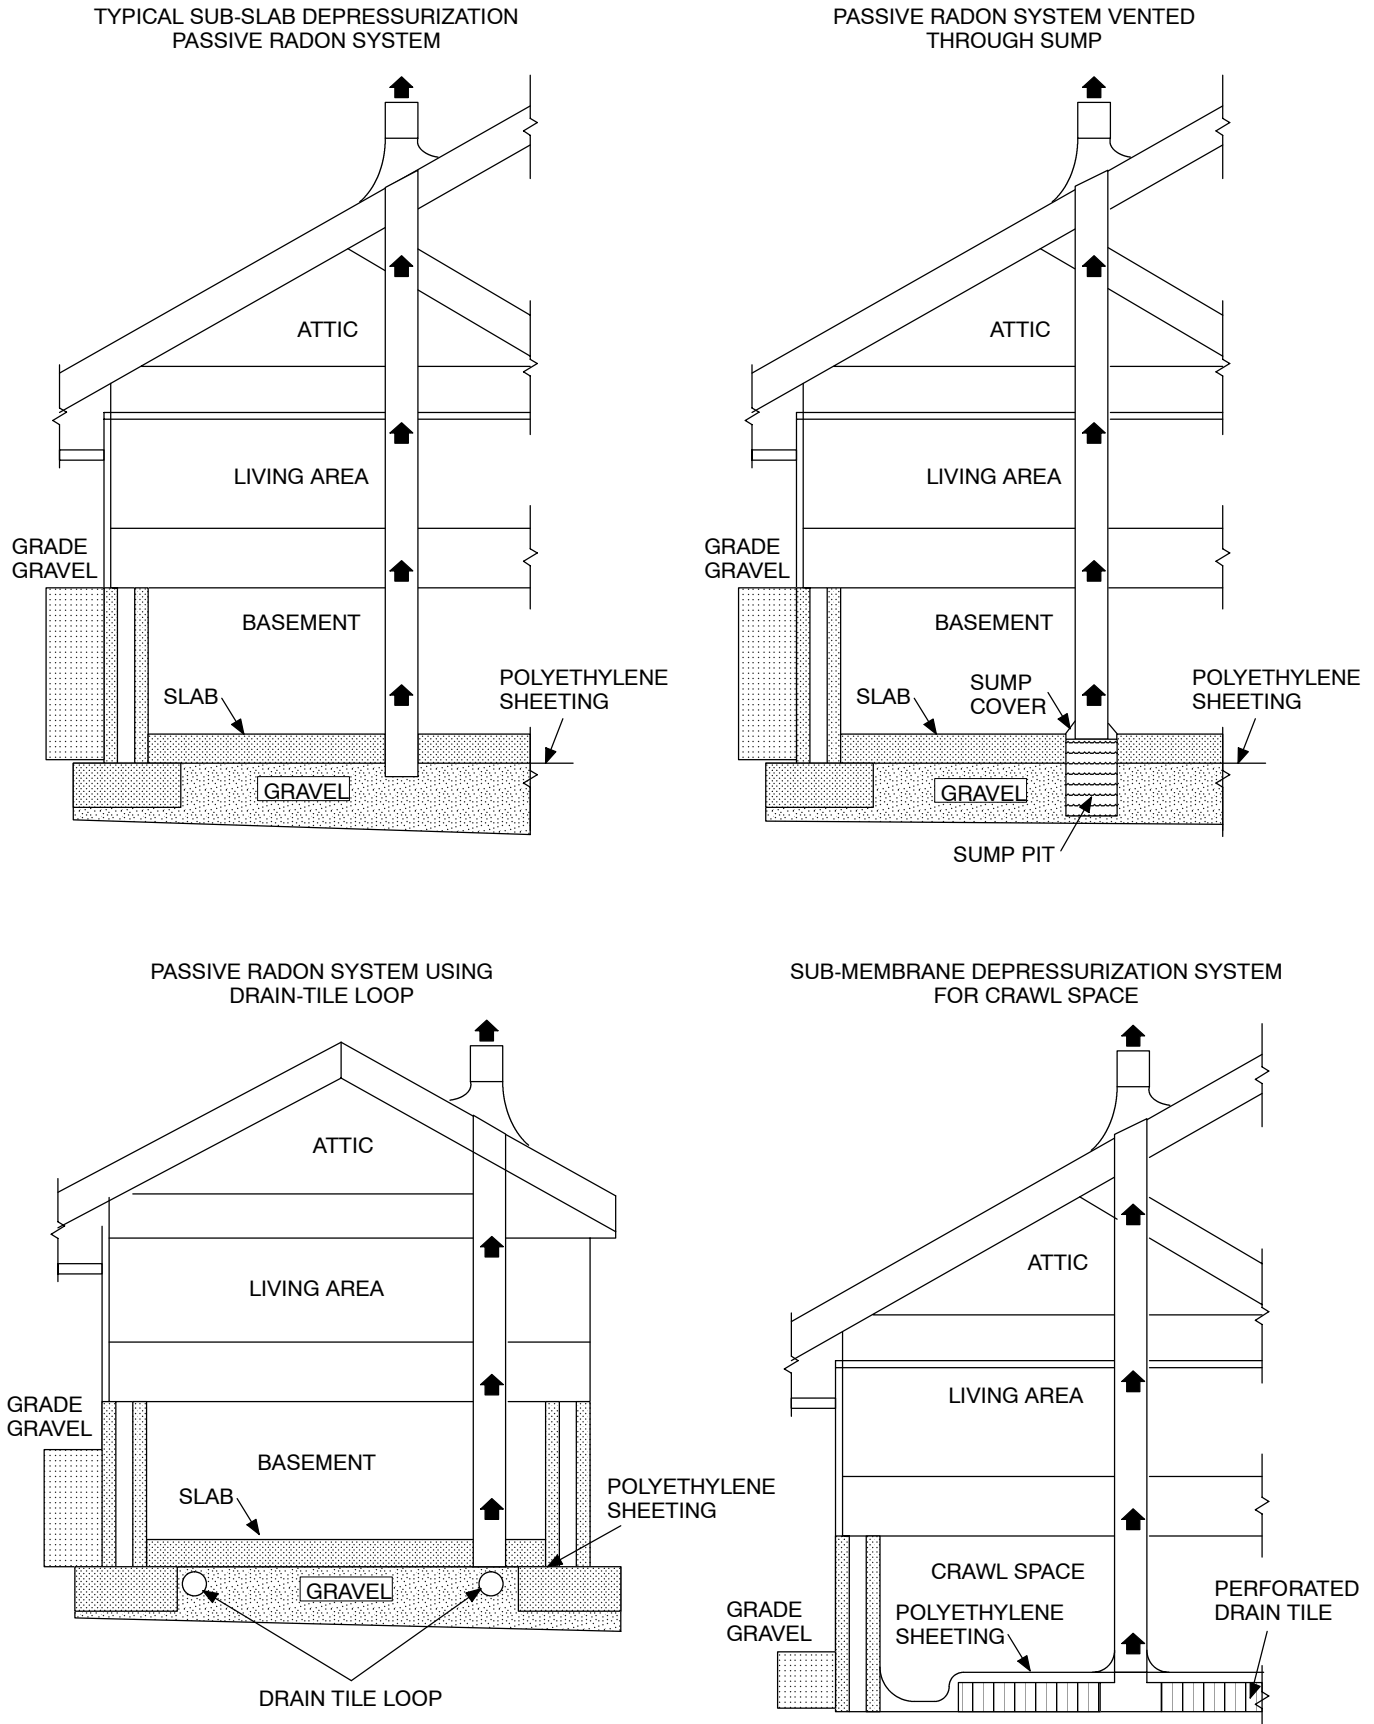


FIGURE AF102
RADON-RESISTANT CONSTRUCTION DETAILS FOR FOUR FOUNDATION TYPES

AF103.9 Vent pipe identification. All exposed and visible interior radon vent pipes shall be identified with at least one label on each floor and in accessible attics. The label shall read: “Radon Reduction System.”

AF103.10 Combination foundations. Combination basement/crawl space or slab-on-grade/crawl space foundations shall have separate radon vent pipes installed in each type of foundation area. Each radon vent pipe shall terminate above the roof or shall be connected to a single vent that terminates above the roof.

AF103.11 Building depressurization. Joints in air ducts and plenums in unconditioned spaces shall meet the requirements of Section M1601. Thermal envelope air infiltration requirements shall comply with the energy conservation provisions in Chapter 11. Firestopping shall meet the requirements contained in Section R602.8

AF103.12 Power source. To provide for future installation of an active sub-membrane or sub-slab depressurization system, an electrical circuit terminated in an approved box shall be installed during construction in the attic or other anticipated location of vent pipe fans. An electrical supply shall also be accessible in anticipated locations of system failure alarms.

